

NOTE: MULTIPLE (REDUNDANT) EGRESS DOORS ARE PROVIDED FROM THIS SPACE, IN ORDER TO ALLOW FLEXIBLE SEATING ARRANGEMENTS. MAIN EGRESS AISLES SHALL BE MAINTAINED AT 44" CLEAR WIDTH, AND SECONDARY EGRESS AISLES (SERVING LESS THAN 50) SHALL BE MAINTAINED AT 36" CLEAR WIDTH.

**COVERED POOL**  
 8 OCC. IN POOL  
 POOL DECK  
 1,480 SF  
 15 NET  
 99 OCC.  
 107 TOTAL OCC.

EVERY EXTERIOR EGRESS DOOR SHALL PROVIDE A LEVEL TRANSITION TO AN EXTERIOR WALKWAY ON THE ACCESSIBLE ROUTE, PER CODE NOTE #3 ON SHEET LS-1.


EXERCISE ROOM 1  
 14'-0"  
 1,821 SF  
 50 GROSS  
 37 OCC.

73'-10" MAX. TRAVEL DIST. TO EXIT. THIS SPACE QUALIFIES FOR A SINGLE MEANS OF EGRESS PER FBC 1004.1.2.

**DRAWING SYMBOLS**

 FLOOR AREA OF ZONE SQ. FT. PER OCCUPANT (PER OCCUPANT LOAD FACTORS CITED) OCCUPANTS IN ZONE	 EGRESS DOOR REQ. F = FIRE-RATED EXIT HARDWARE P = PANIC EXIT HARDWARE FP = FIRE-RATED PANIC EXIT HARDWARE S = WHERE PANIC HARDWARE IS NOT USED ON EXTERIOR DOORS, PROVIDE SIGN STATING "THIS EXIT TO REMAIN UNLOCKED WHEN THIS BUILDING IS OCCUPIED" SEE CODE NOTE 8. EGRESS NUMBER & NUMBER OF EGRESS ROUTES REQ'D FOR AREA SERVED OCCUPANT LOAD SERVED BY EGRESS REQ'D EGRESS WIDTH (INCHES)	NOTE: CALCULATED OCCUPANT LOAD AT EGRESS DOORS INCLUDE, WHERE APPLICABLE, CONTRIBUTION OF OCCUPANTS FROM MULTIPLE ZONES (I.E. ACCUMULATED).
 AUXILIARY DOOR REQ. F = FIRE-RATED HARDWARE AUXILIARY DOOR - NOT REQUIRED TO SERVE AS AN EXIT, BASED UPON OCC. LOAD, TRAVEL DISTANCE AND NUMBER OF OTHER EXITS PROVIDED.	 DOOR TYPE OPENING NUMBER (SEE SHEET DS-1 FOR DOOR SCHEDULE)	
 4-A:80B:C TYP. (FE) 10 LB. CLASS K (K)	PROVIDE PORTABLE FIRE EXTINGUISHERS IN DISTRIBUTED (BUT ACCESSIBLE AND CONSPICUOUS) LOCATIONS, PER NFPA 1, SECTION 13.6.6 AND AS FOLLOWS: PROVIDE EXTINGUISHERS IN COMPLIANCE W/ NFPA 10 AT THE FOLLOWING (MIN.) LOCATIONS:  IN AREAS OTHER THAN CORRIDORS: INSTALL 4-A:80B:C (10 LB ABC) EXTINGUISHERS IN 1,500 MAX. SQ. FT. ZONES, AND WITHIN 75 FT. DISTANCE OF ANY POINT.  IN ONE-HOUR FIRE RATED CORRIDOR: INSTALL 4-A:80B:C (10 LB ABC) EXTINGUISHERS WITHIN 75 FT. DISTANCE OF ANY POINT WITHIN THE PROTECTED CORRIDOR.  IN KITCHENS, INSTALL 10 LB CLASS K EXTINGUISHERS WITHIN 30 FT. OF ALL COOKING APPLIANCES.	

**PARTIAL AREA 4 CLUBHOUSE LIFE SAFETY PLAN**

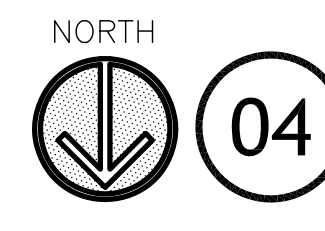

SCALE: 3/16"=1'-0"

DATE: 07-26-11 REVISION LOG: 08-01-11 08-17-11 ENGINEER OF RECORD: <b>CLEAR</b> ENGINEERING 13851 CRYSTAL RIVER DRIVE ORLANDO, FL 32829 TEL: (407) 558-5981 FAX: (407) 558-5981 www.clear-eng.com	SUB-CONSULTANT: ARCHITECT: Timothy Gaus, AIA, LLC Architecture & Planning FL Licensed Architect No. AA 3002419 LEED® Accredited Professional 1984 - Member, Institute of Business Development, 2011	CLIENT: Trilogi 1855 N. E. Clearwater Drive, Suite 370 South Shore, FL 33708	PROJECT: TRILOGI ORLANDO AMENITY CENTER - PHASES 2 & 3 GROVELAND, FLORIDA	DRAWING TITLE: CLUBHOUSE LIFE SAFETY PLAN PARTIAL AREA 4	PROJ. NO: 71137 - 1124 CAD FILE: SHEET NO: LS-4
--	---	---	---	--	--